



**BOARD OF COUNTY  
COMMISSIONERS**

WWW.BAYCOUNTYFL.GOV

840 WEST 11<sup>TH</sup> STREET  
PANAMA CITY, FL 32401

COMMISSIONERS:

TOMMY HAMM  
DISTRICT I

ROBERT CARROLL  
DISTRICT II

WILLIAM T. DOZIER  
DISTRICT III

KEITH BAKER  
DISTRICT IV

PHILIP "GRIFF" GRIFFITTS  
DISTRICT V

ROBERT J. MAJKA JR.  
COUNTY MANAGER

**Purchasing Department  
840 West 11<sup>th</sup> Street, Suite 2500  
Panama City, FL 32401  
Telephone: (850) 248-8270  
Fax: (850) 248-8276**

April 1, 2019

Prospective Respondents

**RE: Addendum #4  
RFP 19-33 Steelfield Road Landfill Expansion Project Design Build  
Team**

Please accept this as Addendum No. 4 for the above referenced solicitation.

The Schedule of Values is provided in excel format and is available for download from the County's website.

The following changes are made to the drawing sheets issued with Addendum #2. Accordingly attached sheets should replace the drawing sheets submitted with Addendum #2.

**Sheet 00D-01**

Detail 1

A minimum of 2-foot structural fill thickness is required below the geosynthetic liner components within the limits of Cells 1 and 2 vertical expansion. A minimum 1-foot thickness shown in the drawing set issued with Addendum #2 is a typo.

In addition specification Section 02300 Part 3.4 F, items 3 and 4 should be revised to maintain minimum 2-foot soil cover below the liner.

Detail 5

The maximum expected height of the gravel berm dividing Cells 6A and 6B is 8 feet. The 14-foot maximum height shown in the drawing set issued with Addendum #2 is a typo.

**Sheet 01C-01**



Profile C

Approximate groundwater elevation in Profile C is incorrectly shown in the drawing set issued with Addendum #2. It is now adjusted to show approximately 44 ft NAVD in the area concerned.

All respondents shall acknowledge receipt of this addendum by signing and submitting, with their submittal, the addendum acknowledgement form included in the RFP package.


Sincerely,  
Wendi Nation  
Purchasing Director

**LEGEND**

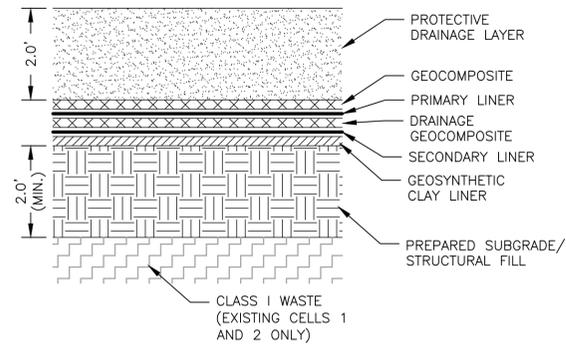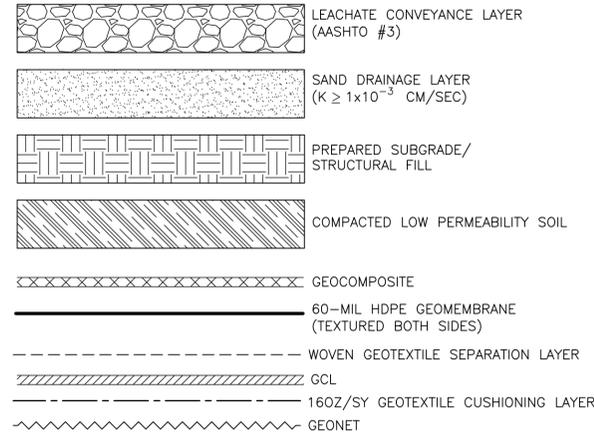


**NOTES:**  
 1. THE PREPARED SUBGRADE SHALL HAVE A MINIMUM 2-FOOT THICKNESS WITHIN THE LIMITS OF CELLS 1 AND 2 WASTE. THE OTHER AREAS SHALL HAVE A COMPACTED SURFACE PER THE SPECIFICATION BEFORE PLACEMENT OF LINER.


**BOTTOM LINER SYSTEM** 1  
 000-01  
 NOT TO SCALE

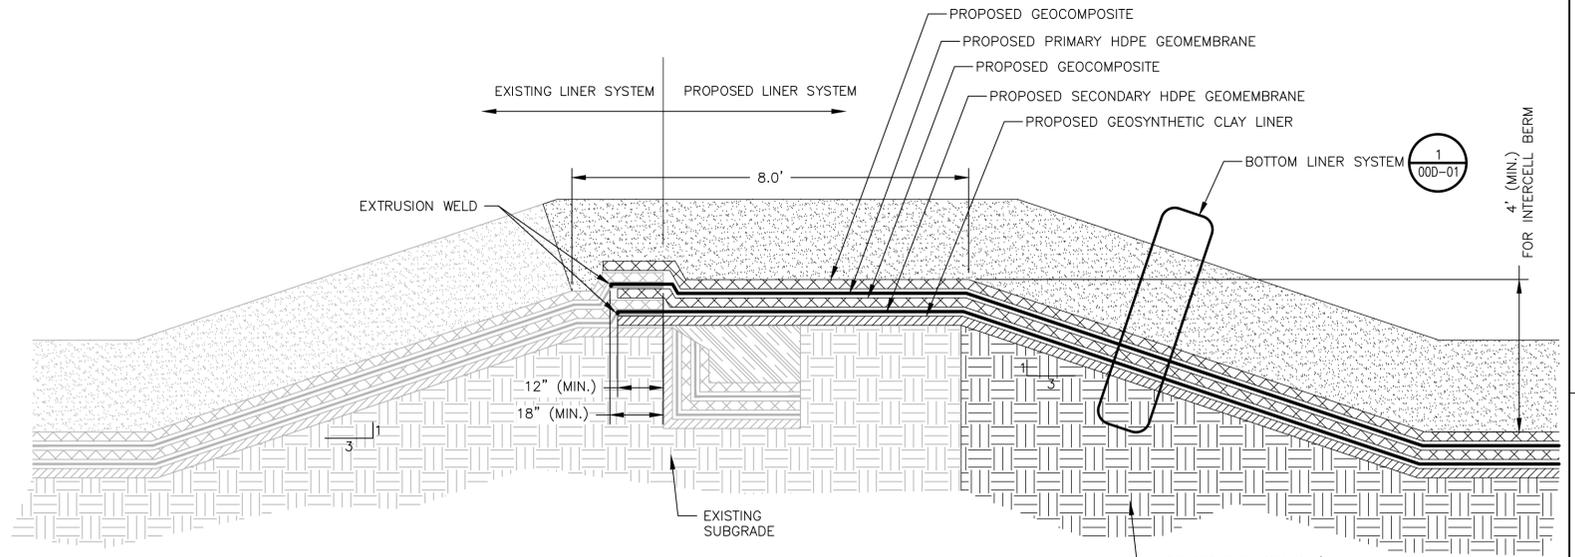


**DOUBLE LINER TIE-IN AND CELL 6 & 7 INTERCELL BERM** 3  
 000-03  
 NOT TO SCALE

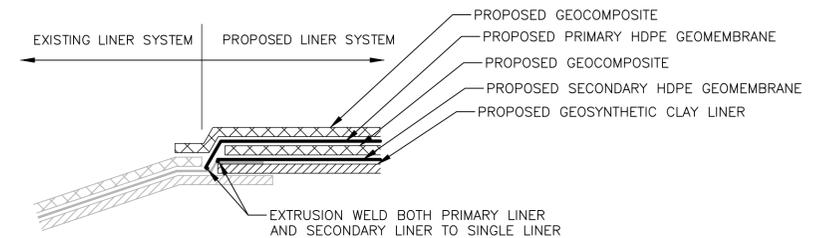

**SINGLE LINER TIE-IN** 4  
 000-03  
 NOT TO SCALE

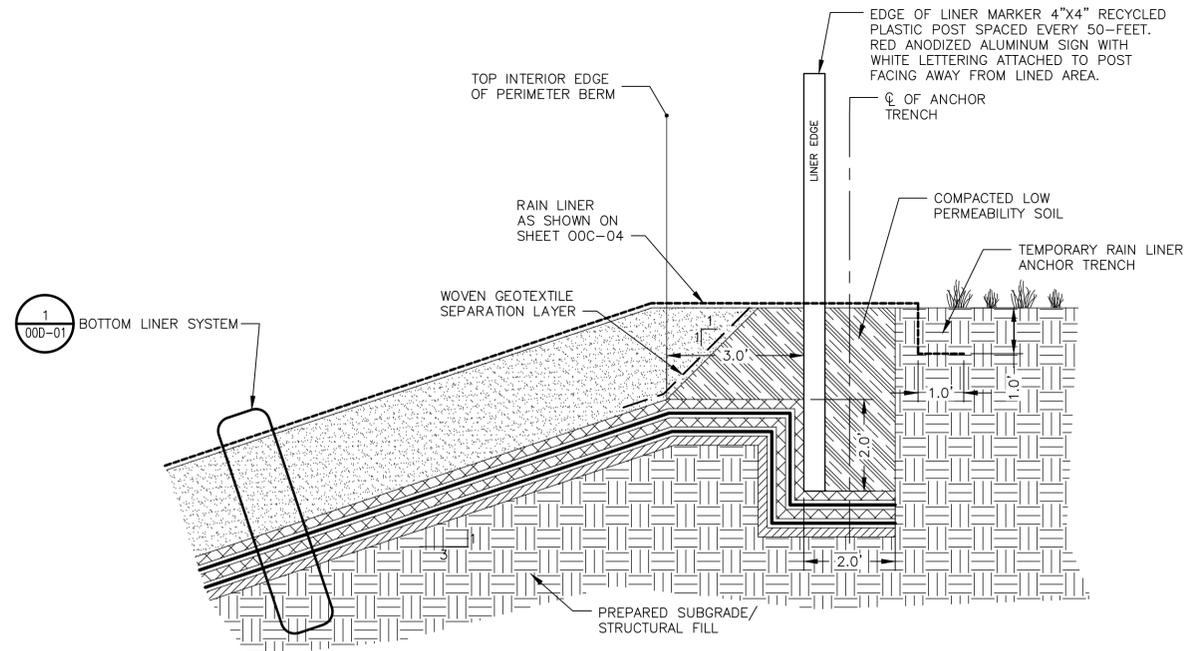

**ANCHOR TRENCH CORRIDOR** 2  
 000-03  
 NOT TO SCALE

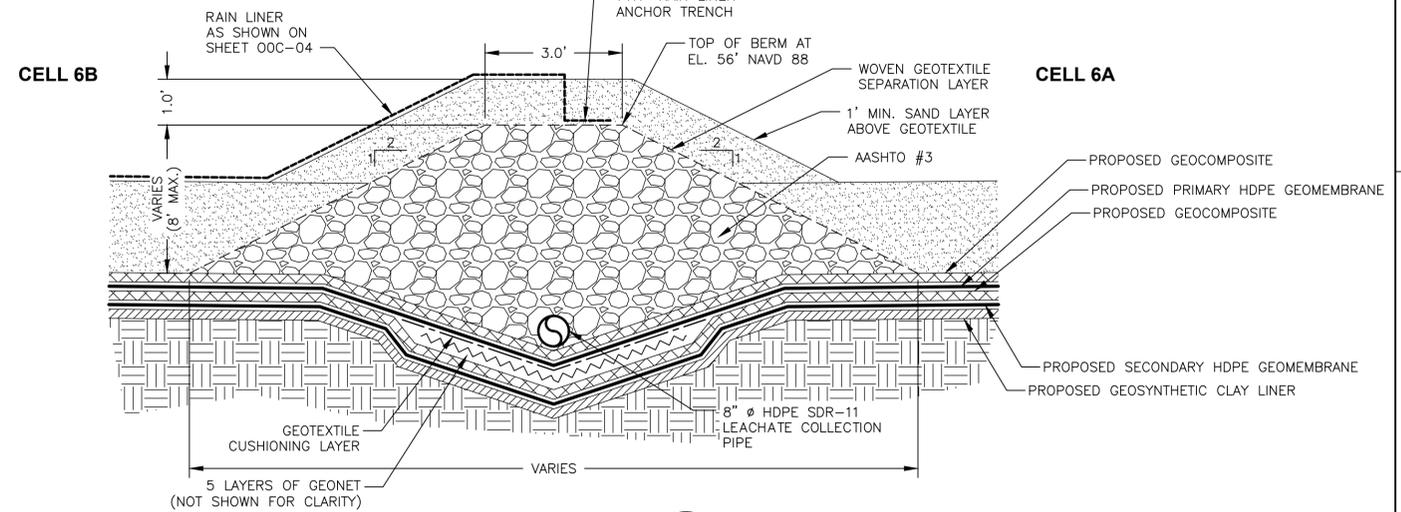

**INTRACELL BERM** 5  
 000-04  
 NOT TO SCALE



ISSUE	DATE	DESCRIPTION
C	03/29/2019	ADDENDUM #4 TO RFP NO. 19-33
B	03/08/2019	ADDENDUM #2 TO RFP NO. 19-33
A	02/11/2019	ISSUED FOR RFP NO. 19-33

<b>PROJECT MANAGER</b>	M. ROBERTS, P.E.
<b>DESIGNED BY</b>	K. PERERA, P.E.
<b>DRAWN BY</b>	J. RAYMOND
<b>CHECKED BY</b>	M. ROBERTS, P.E.
<b>CHECKED BY</b>	T. YANOSCHAK, P.E.
<b>PROJECT NUMBER</b>	10150537



**STEELFIELD ROAD LANDFILL EXPANSION**

BAY COUNTY





FLORIDA

**CELL CONSTRUCTION DETAILS (SHEET 1 OF 5)**




FILENAME | 00D-01.dwg  
 SCALE | AS SHOWN


SHEET  
**00D-01**

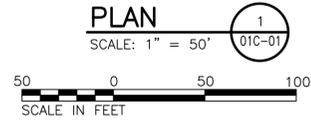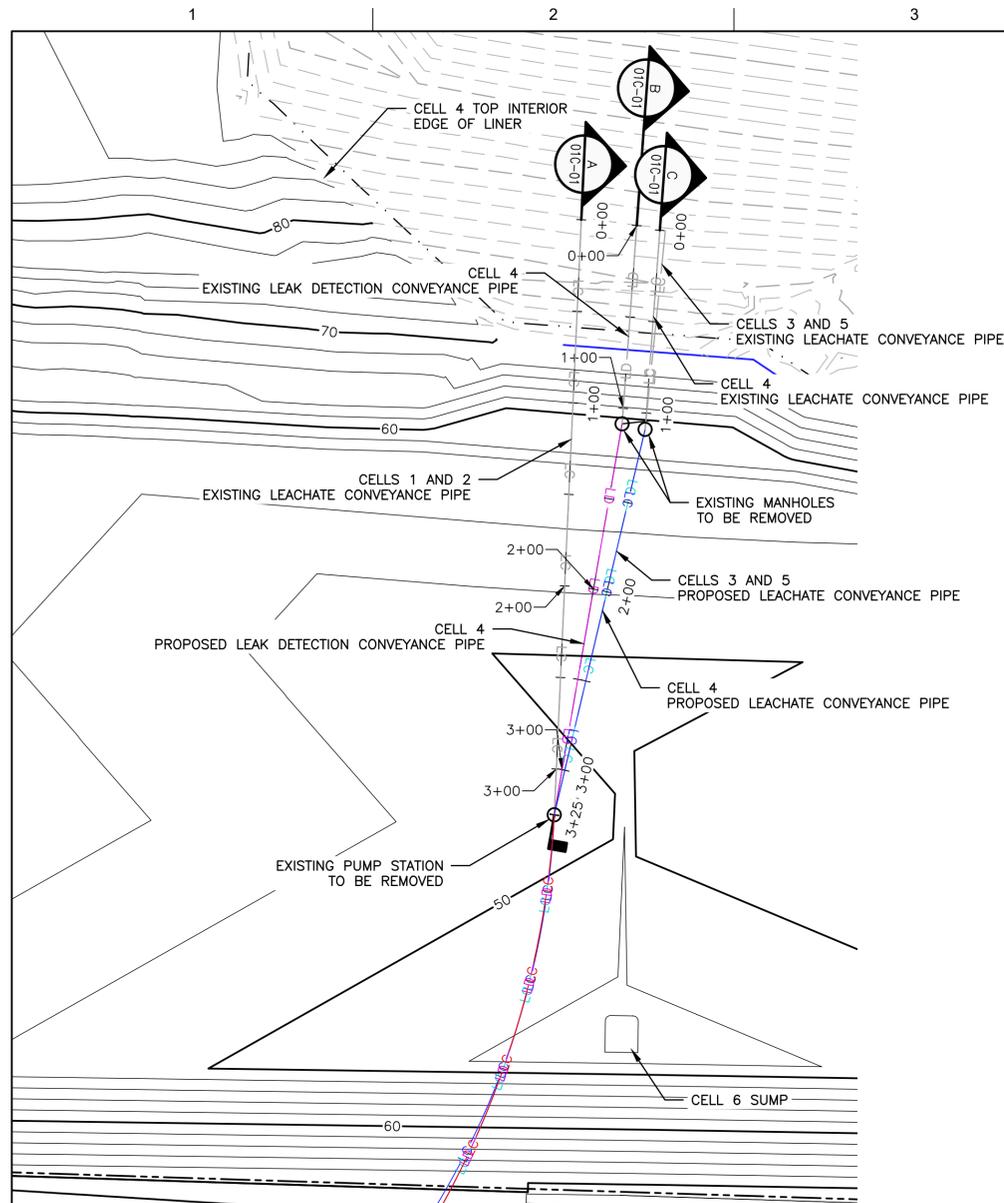


- PLAN LEGEND**
- EXISTING MINOR CONTOUR
  - 40 EXISTING MAJOR CONTOUR
  - PROPOSED MINOR CONTOUR
  - 40 PROPOSED MAJOR CONTOUR
  - LC EXISTING LEACHATE CONVEYANCE PIPE
  - LD EXISTING LEAK CONVEYANCE PIPE
  - LC PROPOSED CELLS 1 AND 2 LEACHATE CONVEYANCE PIPE
  - LC PROPOSED CELLS 3 AND 5 LEACHATE CONVEYANCE PIPE
  - LC PROPOSED CELL 4 LEACHATE CONVEYANCE PIPE
  - LD PROPOSED CELL 4 LEAK DETECTION CONVEYANCE PIPE

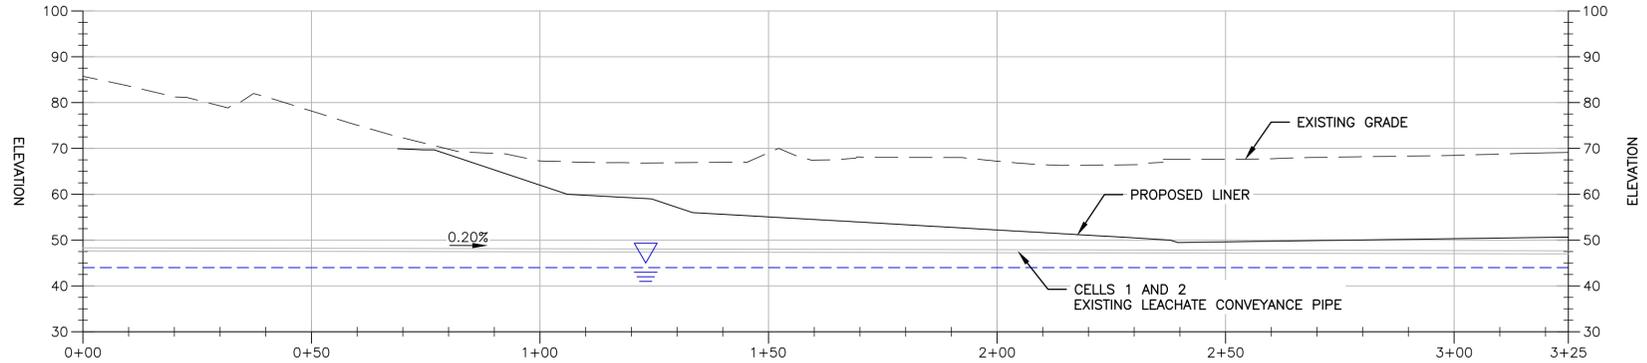

**CELLS 1 AND 2 LEACHATE CONVEYANCE PROFILE**  
SCALE: 1" = 20'

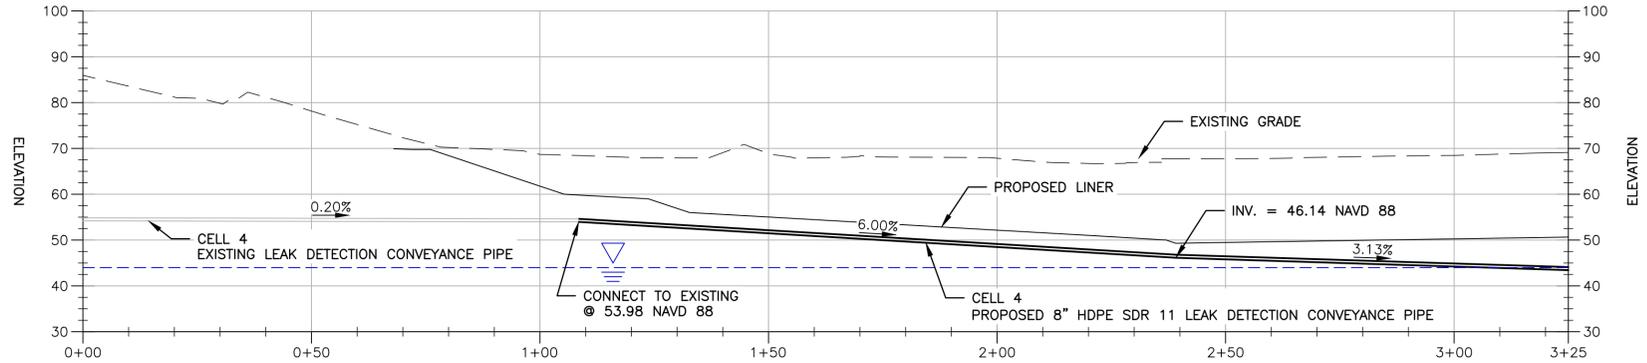

**CELL 4 LEAK DETECTION CONVEYANCE PROFILE**  
SCALE: 1" = 20'

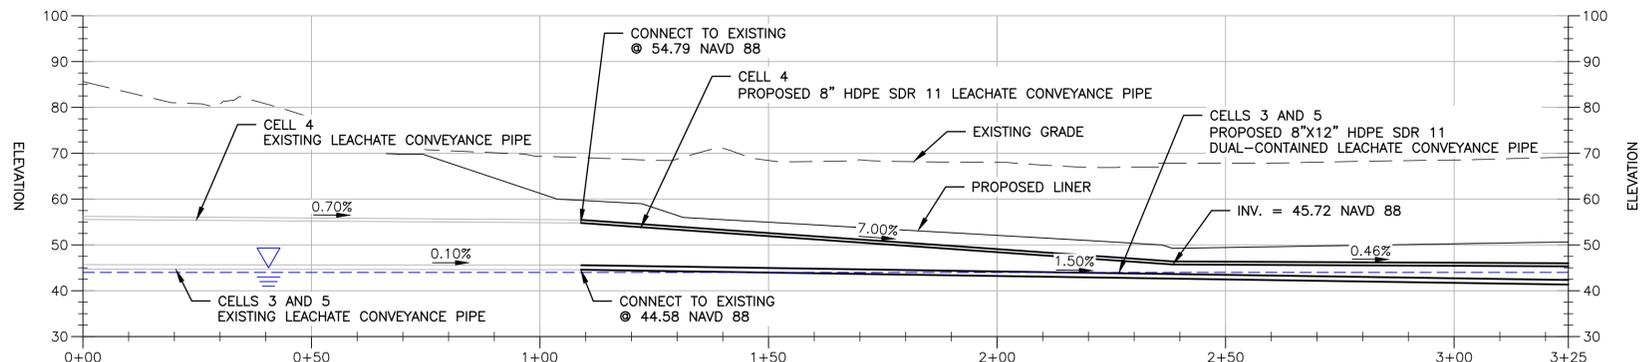

**CELLS 3, 4, AND 5 LEACHATE CONVEYANCE PROFILE**  
SCALE: 1" = 20'



- PROFILE LEGEND**
- EXISTING GRADE
  - PROPOSED GRADE
  - GROUNDWATER (SEASONAL HIGH WATER TABLE)

- NOTES:**
1. EXISTING TOPOGRAPHIC SURVEY BASED ON LIDAR DATA OBTAINED FROM BAY COUNTY, FLORIDA, DATED 2006 AND GROUND SURVEYS PERFORMED BY BAY COUNTY PUBLIC WORKS DEPARTMENT, DATED 03/21/17 AND 02/22/18. THE MINIMUM CLEARANCE BETWEEN BOTTOM OF LINER AND TOP OF PIPE IS 2 FEET.
  2. GROUNDWATER DEWATERING REQUIRED.



ISSUE	DATE	DESCRIPTION
C	03/29/2019	ADDENDUM #4 TO RFP NO. 19-33
B	03/08/2019	ADDENDUM #2 TO RFP NO. 19-33
A	02/11/2019	ISSUED FOR RFP NO. 19-33


<b>PROJECT MANAGER</b>	M. ROBERTS, P.E.
<b>DESIGNED BY</b>	K. PERERA, P.E.
<b>DRAWN BY</b>	J. RAYMOND
<b>CHECKED BY</b>	M. ROBERTS, P.E.
<b>CHECKED BY</b>	T. YANOSCHAK, P.E.
<b>PROJECT NUMBER</b>	10150537



**STEELFIELD ROAD LANDFILL EXPANSION**

**BAY COUNTY FLORIDA**

**MODIFICATION TO EXISTING LEACHATE TRANSMISSION SYSTEM: PLAN AND PROFILE (SHEET 1 OF 2)**



FILENAME | 01C-01.dwg  
SCALE | AS SHOWN  
SHEET | 01C-01